



ELEVATION

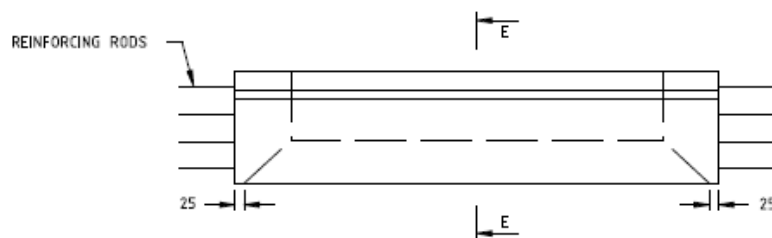


PLAN

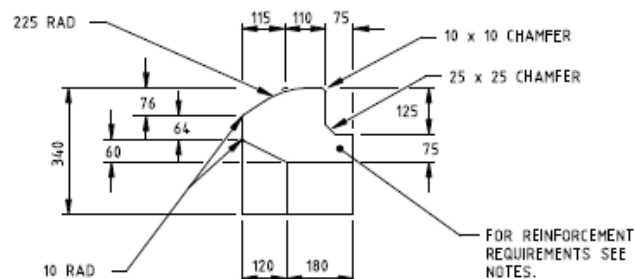


SECTION E-E


SM TYPE LINTELS

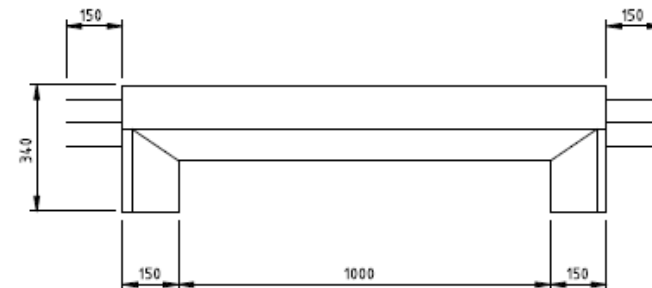

ELEVATION

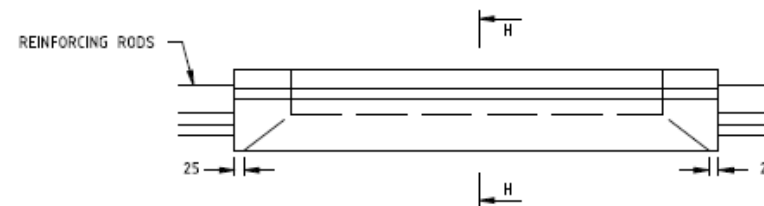

PLAN

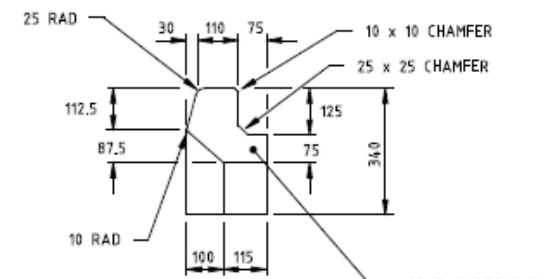

SECTION H-H

B TYPE LINTELS

NOTES

1. STANDARD LINTELS ARE REQUIRED TO SUPPORT A TEST LOAD OF 100 kN
2. STEEL REINFORCEMENT SHALL COMPLY WITH SECTION 611 OF VICROADS SPECIFICATION.
3. CONCRETE SHALL BE CONCRETE GRADE N40 OR HIGHER COMPLYING WITH AS 1379. EXPOSURE CLASSIFICATIONS UP TO AND INCLUDING B1.
4. MINIMUM CLEAR COVER TO REINFORCEMENT 25 mm FOR PRECAST CONCRETE UNITS.

DISCLAIMER (APRIL '23): THIS DRAWING IS IN THE PROCESS OF BEING UPDATED. FOR ALL STRUCTURAL REQUIREMENTS REFER [BRIDGE TECHNICAL NOTE \(BTN\) 033: STRUCTURAL REQUIREMENTS FOR REINFORCED CONCRETE DRAINAGE PITS](#). GEOMETRIC DIMENSIONS SHOWN ON THIS DRAWING MAY BE USED AS A GUIDE AND MODIFIED WHERE NECESSARY TO ACHIEVE COMPLIANCE.

ISSUE	APP'D	DATE	AMENDMENT
E			
D			
C	J.K.	1/7/95	AMENDMENT TO NOTE 1, NOTE 3 AND NOTE 5
B	J.C.	1/2/98	AMENDMENT TO NOTE 3, CONCRETE STRENGTH GRADES.
A	J.C.	1/9/94	NOTES GEN. NOTES 1 & 2, LENGTH OF REINFORCEMENT ROD EXTENSIONS, DOTTED LINES ON PLAN AND ELEVATION.

GENERAL NOTES	
1.	KERBS - SD 2001
2.	ALL DIMENSIONS ARE IN MILLIMETRES

DESIGNED	PRINCIPAL ROAD DESIGN ENGINEER
APPROVED	22.9.94
CATALOG	PRED
PROJECT	sdggnw
FILENAME	sd-1011d.dgn



3 PROJECT HILL ROAD,
CARBONELL,
VICTORIA 3084
PHONE 03 9350 7000
FAX 03 9350 7000

SCALE	HDR	NOT TO SCALE
UP	OF	
METRES	VER	

STANDARD DRAWING				
LINTELS				
FILE NO.	CONTRACT NO.	SHEET NO.	DRAWING NO.	ISSUE
			SD 1061	C